

of gridable vehicles in limited and restricted parking lots, i.e., maximization of profit. This paper makes a bridge between UC and V2G research areas and is the first one to consider UC with gridable vehicles. It extends the area of unit commitment bringing in the V2G technology and making it a success.

Unit commitment with V2G is introduced for the first time in this paper. The rest of the paper is organized as follows. In Section II, problem formulation and constraints of the UC-V2G are discussed. The proposed method, applied distributions and important operations are explained in Section III. Simulation results are reported in Section IV. Finally, conclusion is drawn in Section V.

II. UC-V2G PROBLEM FORMULATION

A. Nomenclature and Acronyms

The following notations are used in this paper.

N	: Number of units
H	: Scheduling hour
K	: Number of buses with loads
L	: Number of transmission lines
$I_i(t)$: i th unit status at hour t (1/0 for on/off)
$P_i(t)$: Output power of i th unit at time t
P_i^{max}	: Maximum output limit of i th unit
P_i^{min}	: Minimum output limit of i th unit
$P_i^{max}(t)$: Maximum output power of unit i at time t considering ramp rate
$P_i^{min}(t)$: Minimum output power of unit i at time t considering ramp rate
$D(t)$: Load demand at time t
$D_K(t)$: Load at bus K at time t
$R(t)$: System reserve requirement at hour t
MU_i/MD_i	: Minimum up/down time of unit i
$X_i^{on}(t)$: Duration of continuously on of unit i at time t
$X_i^{off}(t)$: Duration of continuously off of unit i at time t
$SC_i()$: Start-up cost function of unit i
$FC()$: Fuel cost function
$h-cost_i$: Hot start cost of i th unit
$c-cost_i$: Cold start cost of i th unit
$c-s-hour_i$: Cold start hour of i th unit
RUR_i	: Ramp up rate of unit i
RDR_i	: Ramp down rate of unit i
\bar{F}_l	: Real power flow limit on transmission line l
Γ_l	: The matrix relating generator output to power flow on transmission line l
P_v	: Capacity of each vehicle
$N_{V2G}^{max}(t)$: Maximum parking lot capacity at hour t
$N_{V2G}(t)$: No. of vehicles connected to the grid at hour t
N_{V2G}^{max}	: Total vehicles in the system
SoC	: State of charge
$Effi$: Efficiency
ELD	: Economic load dispatch
\mathcal{TC}	: Total cost

B. Objective Function

Usually large cheap units are used to satisfy base load demand of a system. Most of the time, large units are therefore on and they have slower ramp rates. On the other hand, small units have relatively faster ramp rates. In unit commitment problem, main challenge is to properly schedule

small expensive units to handle uncertain, fluctuating and peak loads. Gridable vehicles of V2G technology will reduce dependencies on small/micro expensive units. But number of gridable vehicles in V2G is much higher than small/micro units. So profit, spinning reserve, reliability of power systems vary on scheduling optimization quality.

UC-V2G is an optimization problem. The objective of the UC-V2G is to minimize total running cost which includes mainly fuel cost and startup cost.

1. Fuel cost

Fuel cost of a thermal unit is expressed as a second order function of each unit output as follow:

$$FC_i(P_i(t)) = a_i + b_i P_i(t) + c_i P_i^2(t) \quad (1)$$

where a_i , b_i and c_i are positive fuel cost co-efficients.

2. Start-up cost

The start-up cost for restarting a decommitted thermal unit, which is related to the temperature of the boiler, is included in the model. If the unit is cold which means that it has been shut down for a long time, it is necessary to consume more fuel to warm up the boiler. If the unit has been decommitted for a short while (which satisfies the minimum down time), less energy will be needed to restart the unit. In this study, a step function of time-dependent start-up cost is simplified using transition hour (H_i^{off}) from hot to cold start which is defined in (2) and (3). Start-up cost will be high cold cost ($c-cost_i$) when down time duration (X_i^{off}) exceeds cold start hour ($c-s-hour_i$) in excess of minimum down time (MD_i) and will be low hot cost ($h-cost_i$) when down time duration does not exceed $c-s-hour_i$ in excess of minimum down time as follows [3]:

$$SC_i(t) = \begin{cases} h-cost_i & : MD_i \leq X_i^{off}(t) \leq H_i^{off} \\ c-cost_i & : X_i^{off}(t) > H_i^{off} \end{cases} \quad (2)$$

$$H_i^{off} = MD_i + c-s-hour_i. \quad (3)$$

3. Shut-down cost

Shut-down cost is constant and the typical value is zero in standard systems.

Therefore, the objective function of UC-V2G is

$$\begin{aligned} \min \mathcal{TC} &= \text{Fuel cost} + \text{Start-up cost} + \text{V2G cost} \\ &= \sum_{i=1}^N \sum_{t=1}^H [FC_i(P_i(t)) + SC_i(1 - I_i(t-1))] I_i(t) \\ &\quad + \sum_{t=1}^H [P_v N_{V2G}(t)] \end{aligned} \quad (4)$$

subject to (5-13) constraints.

Any new type of cost may be included or any existing type of cost may be excluded from the objective function according to the system operators' demand in the deregulated market. Different weights may also be assigned to different types of cost depending on their relative importance in the changing environment.

C. Constraints

The constraints that must be satisfied during the optimization process are as follows:

1. Gridable vehicle balance in V2G

Total scheduled vehicles during 24 hours is the predefined registered/forecast gridable vehicles for V2G technology.

$$\sum_{t=1}^H N_{V2G}(t) = N_{V2G}^{max}. \quad (5)$$

2. System power balance

The generated power from all the committed units and gridable vehicles must satisfy the load demand and the system losses, which is defined as

$$\sum_{i=1}^N I_i(t) P_i(t) + P_v N_{V2G}(t) = D(t) + Losses. \quad (6)$$

3. Spinning reserve

To maintain system reliability, adequate spinning reserves are required.

$$\sum_{i=1}^N I_i(t) P_i^{max}(t) + P_v^{max} N_{V2G}(t) \geq D(t) + R(t). \quad (7)$$

4. Generation limits

Each unit has generation range, which is represented as

$$P_i^{min} \leq P_i(t) \leq P_i^{max}. \quad (8)$$

5. State of charge

Each vehicle should have a desired departure state of charge (SoC) level.

6. Vehicle parking limits

Each parking lot has space limit for parking vehicles. This constraint is also valid for current limit.

$$N_{V2G}(t) \leq N_{V2G}^{max}(t) \quad (9)$$

7. Charging-discharging frequency

Frequency of charging-discharging of gridable vehicles is considered as 1 per day. It should vary depending on life time and type of batteries. Vehicles will be charged either from wind/solar power or from utility grid during off-peak load when price is low (or free for wind/solar power) and will discharge at peak load when price is high.

8. Efficiency

Charging and inverter efficiencies should be considered.

9. Minimum up/down time

Once a unit is committed/decommitted, there is a predefined minimum time after it can be decommitted/committed again.

$$\left. \begin{aligned} (1 - I_i(t+1))MU_i &\leq X_i^{on}(t), \text{ iff } I_i(t) = 1 \\ I_i(t+1)MD_i &\leq X_i^{off}(t), \text{ iff } I_i(t) = 0 \end{aligned} \right\}. \quad (10)$$

10. Ramp rate

For each unit, output is limited by ramp up/down rate at each hour as follow:

$$P_i^{min}(t) \leq P_i(t) \leq P_i^{max}(t) \quad (11)$$

where $P_i^{min}(t) = \max(P_i(t-1) - RDR_i, P_i^{min})$ and $P_i^{max}(t) = \min(P_i(t-1) + RUR_i, P_i^{max})$.

11. Prohibited operating zone

In practical operation, the generation output P_i of unit i must avoid unit operation in the prohibited zones. The feasible operating zones of unit i can be described as follows:

$$\left. \begin{aligned} P_i^{min} &\leq P_i \leq P_{i,1}^u \\ P_{i,j-1}^l &\leq P_i \leq P_{i,j}^u, \quad j = 2, 3, \dots, Z_i \\ P_{i,Z_i}^l &\leq P_i \leq P_i^{max} \end{aligned} \right\}. \quad (12)$$

where $P_{i,j}^l$ and $P_{i,j}^u$ are lower and upper bounds of the j th prohibited zone of unit i , and Z_i is the number of prohibited zones of unit i .

12. Transmission constraints

Generation must be distributed throughout the system to prevent transmission lines from being overloaded:

$$-\bar{F}_l \leq F_l(t) = \sum_{i=1}^N \Gamma_{l,i} P_i(t) - \sum_{k=1}^K \Gamma_{l,k} D_k(t) \leq \bar{F}_l; \quad l = 1, 2, \dots, L. \quad (13)$$

13. Initial status

At the beginning of the schedule, initial states of all the units and vehicles must be taken into account.

14. Must run units

These units include prescheduled units that must be online due to operating reliability and/or economic considerations.

15. Must out units

Units, which are on forced outages and maintenance, are unavailable for commitment.

III. PROPOSED METHOD

PSO is similar to the other evolutionary algorithms in that the system is initialized with a population of random solutions. Each potential solution, call particles, flies in the D -dimensional problem space with a velocity which is dynamically adjusted according to the flying experiences of its own and its colleagues. The location of the i th particle is represented as $X_i = [x_{i1}, x_{i2}, \dots, x_{iD}]^T$. The best previous position of the i th particle is recorded and called $pbest_i$. The index of the best $pbest$ among all the particles is represented by the symbol g . The location $pbest_g$ is also called $gbest$. The rate of the velocity for the i th particle is represented as $V_i = [v_{i1}, v_{i2}, \dots, v_{iD}]^T$. The modified velocity and position of each particle is calculated using the current velocity and the distance from $pbest$, $gbest$ as (14) and (15).

$$v_{ijt} = w * v_{ijt} + c_1 * rand_1 * (pbest_{ijt} - x_{ijt}) + c_2 * rand_2 * (gbest_{jt} - x_{ijt}). \quad (14)$$

$$x_{ijt} = x_{ijt} + v_{ijt}. \quad (15)$$

In (14), the first term indicates the current velocity of the particle (inertia), second term presents the cognitive part of PSO where the particle changes its velocity based on its own thinking and memory, and the third term is the social part of PSO where the particle changes its velocity based on the social-psychological adaptation of knowledge [23]. All the terms are multiplied by appropriate parameters. For UC-V2G problem, dimension D of a particle \mathcal{P} is $(N + 1)$ times H .

Dimensions of location and velocity are presented by 3 indices as x_{ijt} and v_{ijt} , respectively in the rest of the paper for simplicity where i =particle number, j = generating unit/vehicle and t =Time.

Binary PSO for generating units: To extend the real-valued PSO to binary space, Kennedy and Eberhart calculate probability from the velocity to determine whether x_{ijt} will be in ON state or OFF (0/1). They squashed v_{ijt} using the following logistic function.

$$Pr(v_{ijt}) = \frac{1}{1 + \exp(-v_{ijt})}. \quad (16)$$

$$x_{ijt} = \begin{cases} 1, & \text{if } \mathcal{U}(0,1) < Pr(v_{ijt}) \\ 0, & \text{otherwise.} \end{cases} \quad (17)$$

Discrete PSO for V2G vehicles: At each hour, optimal number of gridable vehicles is needed to determine so that operating cost is minimum. When integer solutions (not necessarily 0 or 1) are needed, one of the options is rounding off the real values of new positions in PSO.

$$x_{ijt} = \text{round}(x_{ijt}). \quad (18)$$

By using discrete PSO instead of binary PSO, dimension of UC-V2G is reduced.

A. Data structure and algorithm of PSO for UC-V2G

In the proposed method, each PSO particle has the following fields for UC-V2G problem,

Particle \mathcal{P}_i {
 Generating unit : An $N \times H$ binary matrix X_i ;
 Vehicle : An $1 \times H$ interger column vector Y_i ;
 Velocity : An $(N + 1) \times H$ real-valued matrix V_i ;
 Fitness : A real-valued cost \mathcal{TC} ;
 }.

Besides, some extra storage is needed for $pbest_i$, $gbest$ and temporary variables, which is acceptable and under typical computer memory limit.

The proposed PSO algorithm for UC-V2G is shown below:

- 1) Initialize
 - Set swarm size ($SwarmSize$), maximum number of generations ($GenerationNumber$), c_1 , c_2 , w , etc.
 - Initial random location: Generate $SwarmSize$ particles randomly.
 - Initial random velocity: Generate initial velocities for all particles in all dimensions randomly.
 - Initial $pbest$ and $gbest$: Initially each particle is itself $pbest_i$. Evaluate all particles and the best is assigned to $gbest$.
- 2) Move: Calculate velocity and location in all dimensions of the current swarm using (14-15). Use binary PSO (16-17) for generating units and discrete PSO (14-15, 18) for gridable vehicles in the same algorithm.
- 3) Repair and calculate ELD: Repair each particle location if any constraint is violated there. It accelerates the

process. Then, calculate economic load dispatch of each feasible particle location (solution).

- 4) Evaluate fitness: Evaluate each feasible location in the swarm using the objective function. Update $pbest$ and $gbest$ locations.
- 5) Check and stop/continue: Print the $gbest$ and stop if $GenerationNumber$ is reached; otherwise increase iteration generation number and go back to Step 2.

B. Constraints Management

Stochastic random PSO particles (solutions) may not always satisfy all the constraints. Constraints may be handled in two ways - direct repair and indirect penalty methods.

- 1) If total number of vehicles is not satisfied, difference between left and right sides of (5) is randomly distributed among 24 hours.
- 2) System power balance is satisfied in ED.
- 3) Nearest (upper/lower) valid limit is assigned for inequality constraints.

If solutions are still invalid after repair, penalty is added to discourage the invalid solutions.

C. ED Calculation

Load demand is distributed among generating units and gridable vehicles. Usually power from each vehicle is constant (P_v). At hour t , if schedule is $[I_1(t), I_2(t), \dots, I_N(t), N_{V2G}(t)]^T$ then power from vehicles is $N_{V2G}(t) * P_v * Effi$ and the remaining demand ($D(t) - N_{V2G}(t) * P_v * Effi$) is fulfilled by running units of schedule $[I_1(t), I_2(t), \dots, I_N(t)]^T$. Lambda iteration is used to calculate economic dispatch (ED) here.

IV. SIMULATION RESULTS

All calculations have been run on Intel(R) Core(TM)2 Duo 2.66GHz CPU, 2.96 GB RAM, Microsoft Windows XP OS and Visual C++ compiler. Base 10-generator system is considered for simulation with 50,000 gridable vehicles which are charged from renewable source. Load demand and unit characteristics of the 10-unit system are collected from [22]. In order to perform simulations on the same condition of [13, 15-16, 18, 22], the spinning reserve requirement is assumed to be 10% of the load demand, cold start-up cost is double of hot start-up cost, and total scheduling period is 24 hours. Convergence depends on proper setting of parameter values.

Parameter values are $SwarmSize = 30$; $GenerationNumber = 1,000$; trust parameters $c_1 = 1.4$, $c_2 = 2.6$; total number of vehicles = 50,000; maximum battery capacity = 25 KWh; minimum battery capacity = 10 KWh; average battery capacity, $P_v = 15$ KWh; maximum parking lot capacity at each hour, $N_{V2G}^{max}(t) = 10\%$ of total vehicles; charging-discharging frequency = 1 per day; scheduling period = 24 hours; departure state of charge, SoC = 50%; efficiency = 85%.

TABLE I
DISPATCH SCHEDULE AND RESERVE POWER OF UC WITH 50,000 GRIDABLE VEHICLES

Time (H)	U-1 (MW)	U-2 (MW)	U-3 (MW)	U-4 (MW)	U-5 (MW)	U-6 (MW)	U-7 (MW)	U-8 (MW)	U-9 (MW)	U-10 (MW)	Vehicles (MW)	Max. capacity (MW)	Demand (MW)	Reserve (MW)
1	455.0	229.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	15.14	940.3	700.0	240.3
2	455.0	282.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	12.27	934.5	750.0	184.5
3	455.0	261.5	130.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3.44	1046.9	850.0	196.9
4	455.0	330.4	130.0	0.0	25.0	0.0	0.0	0.0	0.0	0.0	9.52	1221.0	950.0	271.0
5	455.0	384.2	130.0	0.0	25.0	0.0	0.0	0.0	0.0	0.0	5.74	1213.5	1000.0	213.5
6	455.0	355.8	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	4.17	1340.3	1100.0	240.3
7	455.0	391.7	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	18.25	1368.5	1150.0	218.5
8	455.0	442.7	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	17.28	1366.6	1200.0	166.6
9	455.0	455.0	130.0	130.0	62.1	20.0	25.0	0.0	0.0	0.0	22.88	1542.8	1300.0	242.8
10	455.0	455.0	130.0	130.0	162.0	26.9	25.0	10.0	0.0	0.0	6.02	1564.0	1400.0	164.0
11	455.0	455.0	130.0	130.0	162.0	42.2	25.0	10.0	10.0	0.0	30.71	1668.4	1450.0	218.4
12	455.0	455.0	130.0	130.0	162.0	80.0	25.0	10.0	10.0	10.0	23.63	1709.3	1500.0	209.3
13	455.0	455.0	130.0	130.0	155.7	20.0	25.0	10.0	0.0	0.0	19.20	1590.4	1400.0	190.4
14	455.0	455.0	130.0	130.0	77.4	20.0	25.0	0.0	0.0	0.0	7.48	1512.0	1300.0	212.0
15	455.0	446.6	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	13.34	1358.7	1200.0	158.7
16	455.0	303.6	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	6.38	1344.8	1050.0	294.8
17	455.0	256.3	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	3.65	1339.3	1000.0	339.3
18	455.0	348.8	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	11.18	1354.4	1100.0	254.4
19	455.0	400.5	130.0	130.0	25.0	20.0	25.0	0.0	0.0	0.0	14.57	1526.1	1200.0	326.1
20	455.0	455.0	130.0	130.0	152.5	20.0	25.0	10.0	0.0	0.0	22.46	1596.9	1400.0	196.9
21	455.0	455.0	130.0	130.0	71.2	20.0	25.0	0.0	0.0	0.0	13.70	1524.4	1300.0	224.4
22	455.0	339.6	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	20.34	1372.7	1100.0	272.7
23	455.0	312.7	130.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.21	1044.4	900.0	144.4
24	455.0	329.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	15.22	940.4	800.0	140.4
Total running cost = \$559,081.36														

TABLE II
DISPATCH SCHEDULE AND RESERVE POWER OF UC WITHOUT GRIDABLE VEHICLES

Time (H)	U-1 (MW)	U-2 (MW)	U-3 (MW)	U-4 (MW)	U-5 (MW)	U-6 (MW)	U-7 (MW)	U-8 (MW)	U-9 (MW)	U-10 (MW)	Vehicles (MW)	Max. capacity (MW)	Demand (MW)	Reserve (MW)
1	455.0	244.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.00	910.0	700.0	210.0
2	455.0	295.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.00	910.0	750.0	160.0
3	455.0	370.0	0.0	0.0	25.0	0.0	0.0	0.0	0.0	0.0	0.00	1072.0	850.0	222.0
4	455.0	455.0	0.0	0.0	39.9	0.0	0.0	0.0	0.0	0.0	0.00	1072.0	950.0	122.0
5	455.0	389.9	130.0	0.0	25.0	0.0	0.0	0.0	0.0	0.0	0.00	1202.0	1000.0	202.0
6	455.0	359.9	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	0.00	1332.0	1100.0	232.0
7	455.0	410.0	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	0.00	1332.0	1150.0	182.0
8	455.0	455.0	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	0.00	1332.0	1200.0	132.0
9	455.0	455.0	130.0	130.0	84.9	20.0	25.0	0.0	0.0	0.0	0.00	1497.0	1300.0	197.0
10	455.0	455.0	130.0	130.0	162.0	32.9	25.0	0.0	10.0	0.0	0.00	1552.0	1400.0	152.0
11	455.0	455.0	130.0	130.0	162.0	72.9	25.0	0.0	10.0	10.0	0.00	1607.0	1450.0	157.0
12	455.0	455.0	130.0	130.0	162.0	80.0	25.0	42.9	10.0	10.0	0.00	1662.0	1500.0	162.0
13	455.0	455.0	130.0	130.0	162.0	32.9	25.0	10.0	0.0	0.0	0.00	1552.0	1400.0	152.0
14	455.0	455.0	130.0	130.0	84.9	20.0	25.0	0.0	0.0	0.0	0.00	1497.0	1300.0	197.0
15	455.0	455.0	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	0.00	1332.0	1200.0	132.0
16	455.0	309.9	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	0.00	1332.0	1050.0	282.0
17	455.0	260.0	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	0.00	1332.0	1000.0	332.0
18	455.0	359.9	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	0.00	1332.0	1100.0	232.0
19	455.0	455.0	130.0	130.0	25.0	0.0	0.0	0.0	0.0	0.0	0.00	1332.0	1200.0	132.0
20	455.0	455.0	130.0	130.0	162.0	32.9	25.0	10.0	0.0	0.0	0.00	1552.0	1400.0	152.0
21	455.0	455.0	130.0	130.0	84.9	20.0	25.0	0.0	0.0	0.0	0.00	1497.0	1300.0	197.0
22	455.0	455.0	0.0	0.0	144.9	20.0	25.0	0.0	0.0	0.0	0.00	1237.0	1100.0	137.0
23	455.0	420.0	0.0	0.0	25.0	0.0	0.0	0.0	0.0	0.0	0.00	1072.0	900.0	172.0
24	455.0	345.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.00	910.0	800.0	110.0
Total running cost = \$563,741.83														

Randomly selected results with and without gridable vehicles are shown in Tables I and II, respectively. Running cost is \$563,741.83 without V2G and it is \$559,081.36 considering V2G. Therefore, total running cost is reduced by \$4,660.47 for only gridable vehicles; however, other constraints are the same during the schedule 24 hours. Minimum reserve is 140.4 MW using V2G technology and it is 110.0 MW without using V2G. Average reserve is 221.69 MW using V2G technology and it is only 181.54 MW without using V2G.

Fig. 1 shows that the load curve has peaks and valleys, and reserve is always higher when V2G is considered. The system

with V2G is more reliable than traditional system with only generating units. Operators expect that large cheap units (U-1 and U-2) will mainly satisfy base load and other small expensive units (U-3 to U-10) will fulfill fluctuating, peak loads. Gridable vehicles of V2G reduce dependencies on small expensive units.

Table III shows that U-1 and U-7 produce same constant powers, as U-1 is the cheapest, thus it is generating always maximum power, and U-7 is expensive, thus it is generating minimum power whenever it is running; U-2, U-5 to U-6 and U-8 to U-10 produce less power when gridable vehicles are

TABLE III
POWER FROM GENERATING UNITS DURING 24 HOURS

	U-1	U-2	U-3	U-4	U-5	U-6	U-7	U-8	U-9	U-10	Vehicles
With V2G (MW)	10920.0	9056.7	2730.0	2210.0	1279.9	269.1	225.0	50.0	20.0	10.0	318.8
Without V2G (MW)	10920.0	9679.5	2210.0	2080.0	1524.7	331.7	225.0	62.9	30.0	20.0	0.0
V2G Effect (%)	0	6.43	-19.04	-5.88	16.05	18.87	0	20.51	33.33	50	-

TABLE IV
TEST RESULTS OF THE PROPOSED PSO FOR UC WITH V2G (10 RUNS)

No. of units	Success (%)	Total cost				Execution time		
		Best (\$)	Worst (\$)	Average (\$)	Variation (%)	Maximum (sec)	Minimum (sec)	Average (sec)
With V2G	100	557,594.52	559,236.25	558,243.30	0.294	22.05	18.5	20.14
Without V2G	100	563,741.83	565,443.39	564,743.51	0.301	23.47	19.22	21.24

connected in the system, as they are expensive units; however, U-3 and U-4 generate more power when gridable vehicles are connected, as the proposed PSO method makes balance between the increasing and decreasing power generations.

Fig. 2 shows that vehicles are connected to grid and the number of vehicles connected to grid is changing at each hour. It is frequently changing for optimization. Number of vehicles connected to grid is not directly proportional to the load demand; however, maximum number of vehicles is connected during the peak load (11th and 12th hours). It depends on load curve, non-linear price curves and constraints. An optimization method is therefore essential to solve this complex system.

Regarding the optimization algorithm for V2G, PSO solves the problem efficiently. Stochastic results are shown in Table IV. The best, worst, and average findings of the proposed method are reported together with their cost variation as a percentage of the best solution. It always converges. The variation is tolerable. Average result is near to the best result. These facts strongly demonstrate the robustness of the proposed PSO for UC with V2G problem.

Table V shows the comparison of the proposed method to the most recent methods, e.g., integer-coded GA (ICGA) reported in [13], Lagrangian relaxation and genetic algorithm (LRGA) reported in [15], genetic algorithm (GA), dynamic programming (DP) and Lagrangian relaxation (LR) reported in [16], evolutionary programming (EP) reported in [18], and hybrid particle swarm optimization (HPSO) reported in [22] with respect to the total cost. “-” indicates that no result is reported in the corresponding article. The proposed method is

working properly, as results are comparable with existing methods when only number of gridable vehicles is assigned to zero in the algorithm keeping all other resources and constraints the same.

From Table V, it is obvious that the proposed method is superior to other mentioned methods because (a) the DP cannot search all the states of UC problem in real time; (b) it is very difficult to obtain feasible solutions and to minimize the duality gap in LR; (c) most of the cases, SA generates random infeasible solutions in each iteration by the random bit flipping operation; (d) PSO shares many common parts of GA, EP, etc.; however, (i) it has better information sharing and conveying mechanisms than GA, EP; (ii) it has better dynamics of balance between global and local searching abilities; (iii) it needs less memory and simple calculations; (iv) it has no dimension limitation; (v) it is easy to implement. The proposed PSO generates little bit better results than HPSO just for proper parameter settings, swarm size (in the proposed method, swarm size is 30 instead of 20 in HPSO), ED calculations and efficient programming.

Execution time depends on algorithm, computer configuration and efficient program coding. The proposed method is implemented efficiently in Visual C++ and run on a modern system. Table IV shows execution time of the proposed method for UC with V2G. Execution time is acceptable, as it is in second. Execution time is not exponentially growing with respect to the number of gridable vehicles of V2G, as vehicles are treated as a cluster of integer number of vehicles for

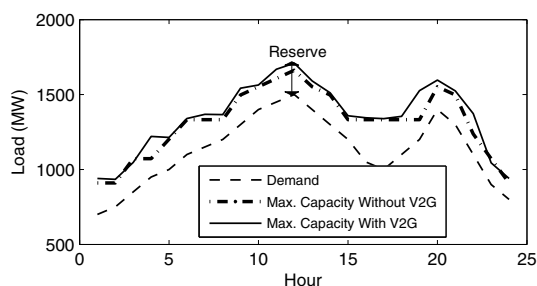


Fig. 1. Reserve power with and without V2G.

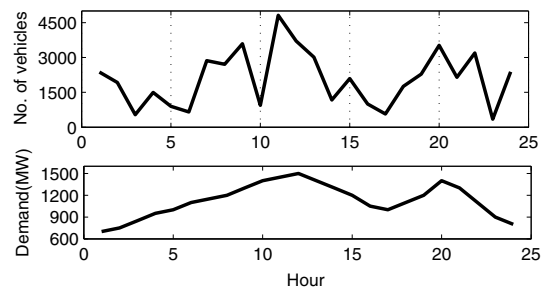


Fig. 2. Vehicles connected to the grid.

TABLE V
COMPARISON OF TOTAL COST - ICGA[13], LRGA[15], GA[16], DP[16], LR[16], EP[18], AG[32],
HPSO[22] AND THE AVERAGE FINDING OF THE PROPOSED PSO

	Total cost (\$)														
	ICGA[13]			LRGA[15]			GA[16]			DP[16]		LR[16]			
	Best	Worst	Avg.	Best	Worst	Avg.	Best	Worst	Avg.	Best	Worst	Avg.	Best	Worst	Avg.
Without V2G	-	-	566404	-	-	564800	565825	570032	-	565825	N/A	N/A	565825	N/A	N/A
With V2G	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

	Total cost (\$)														
	EP[18]			AG[32]			HPSO[22]			Proposed PSO					
	Best	Worst	Avg.	Best	Worst	Avg.	Best	Worst	Avg.	Best	Worst	Avg.	Best	Worst	Avg.
Without V2G	564551	566231	565352	-	-	564005	563942	565785	564772	563,741.8	565443.3	564743.5			
With V2G	-	-	-	-	-	-	-	-	-	557594.5	559236.2	558243.3			

Notes: '-' indicates that result is not reported in the corresponding reference;
 ICGA: Generations = 300, chromosomes = 50, crossover and mutation prob. = not constant;
 LRGA: Generations = 500, population size = 60, duality gap = 0.02, crossover and mutation prob. = 0.8, 0.0333 respectively;
 GA: Generations = 500, chromosomes = 50, adaptive crossover prob. range = 0.4 to 0.9 and adaptive mutation prob. range = 0.004 to 0.024;
 DP: Complete state enumerations for only 10-unit system;
 LR: Multiplier increasing factor=0.01 and decreasing factor=0.97;
 EP: Generations = 500, population size = 50;
 AG: Population size = 70, ini. temperature = 900, crossover prob. = 0.8 and mutation prob. = 0.1;
 HPSO: Maximum iterations = 1000, population size = 20, inertia weight, $w = 1.0$, $c_1 = 2.8$, $c_2 = 1.2$;

discrete PSO (not binary PSO).

Fig. 3 shows the convergence of the proposed PSO for UC with V2G. In the beginning, it converges faster, then converges slowly at the middle of generation and then very slowly or steady from the near final iterations. Therefore, the proposed PSO holds the above fine-tuning characteristic of a good optimization method.

V. CONCLUSION

This paper has introduced for the unit commitment with gridable vehicles based on V2G. The authors have solved the UC with V2G using PSO. In this paper, the contributions are the timely introduction of UC with V2G, and effective optimization of UC with V2G using binary and integer versions of PSO in the same algorithm. From this study, it is clear that UC with V2G reduces operational costs, but it increases profit, reserve and reliability. Finally, this study is a first look at UC with V2G. In future, there is enough scope to include other practical constraints of gridable vehicles and parking lots for real applications of V2G technology.

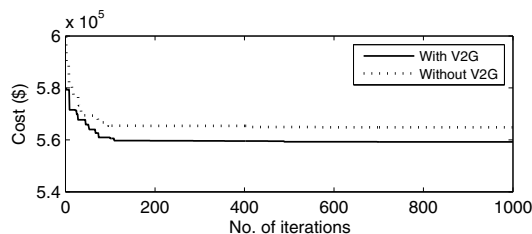


Fig. 3. Convergence of the proposed PSO for UC with V2G.

REFERENCES

- [1] H. H. Happ, R. C. Johnson, and W. J. Wright, "Large scale hydro-thermal unit commitment-method and results," *IEEE Trans. Power Appa. Syst.*, vol. PAS-90, no. 3, pp. 1373-1384, May/June 1971.
- [2] C. J. Baldwin, K. M. Dale, and R. F. Dittich, "A study of economic shutdown of generating units in daily dispatch," *IEEE Trans. Power Appa. Syst.*, vol. PAS-78, pp. 1272-1284, 1960.
- [3] T. Senjyu, K. Shimabukuro, K. Uezato, and T. Funabashi, "A fast technique for unit commitment problem by extended priority list," *IEEE Trans. Power Syst.*, vol. 18, no. 2, pp. 882-888, May 2003.
- [4] A. I. Cohen and M. Yoshimura, "A branch-and-bound algorithm for unit commitment," *IEEE Trans. Power Appa. Syst.*, vol. PAS-102, pp. 444-451, Feb 1983.
- [5] Z. Ouyang and S. M. Shahidehpour, "An intelligent dynamic programming for unit commitment application," *IEEE Trans. Power Syst.*, vol. 6, no. 3, pp. 1203-1209, Aug 1991.
- [6] C. S. Chen, H. J. Chuang, and L. I. Fan, "Unit commitment of main transformers for electrified mass rapid transit systems," *IEEE Trans. Power Delivery*, vol. 17, pp. 747-753, Jul 2002.
- [7] C. K. Pang, G. B. Sheble, and F. Albuyeh, "Evaluation of dynamic programming based methods and multiple area representation for thermal unit commitments," *IEEE Trans. Power Appa. Syst.*, vol. PAS-100, pp. 1212-1218, Mar 1981.
- [8] A. J. Svoboda, C.-L. Tseng, C.-A. Li, and R. B. Johnson, "Short-term resource scheduling with ramp constraints [power generation scheduling]," *IEEE Trans. Power Syst.*, vol. 12, no. 1, pp. 77-83, Feb 1997.
- [9] F. N. Lee, "A fuel-constrained unit commitment method," *IEEE Trans. Power Syst.*, vol. 4, no. 3, pp. 1208-1218, Aug 1989.
- [10] S. Virmani, E. C. Adrian, K. Imhof, and S. Mukherjee, "Implementation of a Lagrangian relaxation based unit commitment problem," *IEEE Trans. Power Syst.*, vol. 4, no. 4, pp. 1373-1380, Nov 1989.
- [11] John J. Shaw, "A direct method for security-constrained unit commitment," *IEEE Trans. Power Syst.*, vol. 10, no. 3, pp. 1329-1342, Aug 1995.
- [12] W. L. Peterson and S. R. Brammer, "A capacity based Lagrangian relaxation unit commitment with ramp rate constraints," *IEEE Trans. Power Syst.*, vol. 10, no. 2, pp. 1077-1084, May 1995.
- [13] I. G. Damousis, A. G. Bakirtzis, and P. S. Dokopoulos, "A solution to the unit-commitment problem using integer-coded genetic algorithm," *IEEE Trans. Power Syst.*, vol. 19, no. 2, pp. 1165-1172, May 2004.
- [14] T. Senjyu, A. Y. Saber, T. Miyagi, K. Shimabukuro, N. Urasaki, and T. Funabashi, "Fast technique for unit commitment by genetic algorithm based on unit clustering," *IEE Proc., Gen. Transm. Dist.*, vol. 152, no. 5, pp. 705-713, Sep 2005.
- [15] C.-P. Cheng, C.-W. Liu, and C.-C. Liu, "Unit commitment by Lagrangian relaxation and genetic algorithms," *IEEE Trans. Power Syst.*, vol. 15, no. 2, pp. 707-714, May 2000.
- [16] S. A. Kazarlis, A. G. Bakirtzis, and V. Petridis, "A genetic algorithm solution to the unit commitment problem," *IEEE Trans. Power Syst.*, vol. 11, no. 1, pp. 83-92, Feb 1996.
- [17] H. Mori and O. Matsuzaki, "Application of priority-list-embedded tabu search to unit commitment in power systems," *Inst. Elect. Eng. Japan*, vol. 121-B, no. 4, pp. 535-541, 2001.
- [18] K. A. Juste, H. Kita, E. Tanaka, and J. Hasegawa, "An evolutionary programming solution to the unit commitment problem," *IEEE Trans. Power Syst.*, vol. 14, no. 4, pp. 1452-1459, Nov 1999.

- [19] J. Kennedy and R. C. Eberhart, "Particle swarm optimization," *Proc. IEEE Int. Conf. on Neural Networks*, pp. 1942-1948, Perth, Australia, 1995.
- [20] Y. Shi and R. C. Eberhart, "Parameter selection in particle swarm optimization," *Proc. of the Seventh Annual Conference on Evolutionary Programming*, IEEE Press, 1998.
- [21] J. Kennedy and R. C. Eberhart, "A discrete binary version of the particle swarm algorithm," *Proc. of IEEE Conf. on Systems, Man, and Cybernetics*, pp. 4104-4109, 1997.
- [22] T. O. Ting, M. V. C. Rao, and C. K. Loo, "A novel approach for unit commitment problem via an effective hybrid particle swarm optimization," *IEEE Trans. Power Syst.*, vol. 21, no. 1, pp. 411-418, Feb 2006.
- [23] Zwe-Lee Gaing, "Particle swarm optimization to solving the economic dispatch considering the generator constraints," *IEEE Trans. Power Syst.*, vol. 18, no. 3, pp. 1187-1195, Aug 2003.
- [24] D. N. Jeyakumar, T. Jayabarathi, and T. Raghunathan, "Particle swarm optimization for various types of economic dispatch problems," *Electrical Power and Energy Systems*, vol. 28, pp. 36-42, 2006.
- [25] H. Yoshida, K. Kawata, Y. Fukuyama, S. Takayama, and Y. Nakanishi, "A particle swarm optimization for reactive power and voltage control considering voltage security assessment," *IEEE Trans. Power Syst.*, vol. 15, no. 4, pp. 1232-1239, Nov 2000.
- [26] V. Miranda, "Evolutionary algorithms with particle swarm movements," *IEEE 13th Int. Conf. on Intelligent Syst. Appli. to Power Syst. (ISAP)*, pp. 6-21, VA, USA, Nov. 6-10, 2005.
- [27] M. Dorigo, V. Maniezzo, and A. Colomi, "The ant system: optimization by a colony of cooperating agents," *IEEE Trans. Syst. Man Cybernetics*, vol. 26, no. 2, pp. 29-41, Part B 1996.
- [28] M. Dorigo and LM. Gambardella, "Ant colony system: a cooperative learning approach to the traveling salesman," *IEEE Trans. Evol. Comput.* vol. 1, no. 1, pp. 53-65, 1997.
- [29] S.-J. Huang, "Enhancement of hydroelectric generation scheduling using ant colony system based optimization approaches," *IEEE Trans. Energy Convers.*, vol. 16, no. 3, pp. 296-301, 2001.
- [30] L. Shi, J. Hao, J. Zhou, and G. Xu, "Ant colony optimisation algorithm with random perturbation behaviour to the problem of optimal unit commitment with probabilistic spinning reserve determination," *Electric Power Syst. Res.*, vol. 69, pp. 295-303, 2004.
- [31] S. P. Simon, N. P. Padhy, and R. S. Anand, "An ant colony system for unit commitment problem," *Electrical Power and Energy Systems*, in the press, 2006.
- [32] T. Satoh and K. Nara, "Maintenance scheduling by using simulated annealing method [for power plants]," *IEEE Trans. Power Syst.*, vol. 6, no. 2, pp. 850-857, May 1991.
- [33] S. Y. W. Wong, "An enhanced simulated annealing approach to unit commitment," *Electric Power Energy Syst.*, vol. 20, pp. 359-368, May 1998.
- [34] F. Zhuang and F. D. Galiana, "Unit commitment by simulated annealing," *IEEE Trans. Power Syst.*, vol. 5, no. 1, pp. 311-318, Feb 1990.
- [35] A. H. Mantawy, Y. L. Abel-Mogid, and S. Z. Selim, "A simulated annealing algorithm for unit commitment," *IEEE Trans. Power Syst.*, vol. 13, no. 1, pp. 197-204, Feb 1998.
- [36] A. H. Mantawy, Y. L. Abel-Mogid, and S. Z. Selim, "Integrating genetic algorithms, tabu search, and simulated annealing for the unit commitment problem," *IEEE Trans. Power Syst.*, vol. 14, no. 3, pp. 829-836, Aug. 1999.
- [37] C.-P. Cheng, C.-W. Liu, and C.-C. Liu, "Unit commitment by annealing-genetic algorithms," *Electrical Power and Energy Systems*, vol. 24, pp. 149-158, 2002.
- [38] G. K. Purushothama and L. Jenkins, "Simulated annealing with local search - A hybrid algorithm for unit commitment," *IEEE Trans. Power Syst.*, vol. 18, no. 1, pp. 273-278, Feb 2003.
- [39] A. H. Mantawy, "A genetic algorithm solution to a new fuzzy unit commitment model," *Electric Power Systems Research*, vol. 72, pp. 171-178, 2004.
- [40] M. M. El-Saadawi, M. A. Tantawi, and E. Tawfik, "A fuzzy optimization based approach to large scale thermal unit commitment," *Electric Power Systems Research*, vol. 72, pp. 245-252, 2004.
- [41] N. P. Padhy, "Unit commitment using hybrid models: a comparative study for dynamic programming, expert system, fuzzy system and genetic algorithms," *Electrical Power and Energy Systems*, vol. 23, pp. 827-836, 2000.
- [42] C.-C. Su and Y.-Y. Hsu, "Fuzzy dynamic programming: An application to unit commitment," *IEEE Trans. Power Syst.*, vol. 6, no. 3, pp. 1231-1237, Aug 1991.
- [43] S. Saneifard, N. R. Prasad, and H. A. Smolleck, "A fuzzy logic approach to unit commitment," *IEEE Trans. Power Syst.*, vol. 12, no. 2, pp. 988-995, May 1997.
- [44] A. Y. Saber, T. Senjyu, T. Miyagi, N. Urasaki, and T. Funabashi, "Fuzzy unit commitment scheduling using absolutely stochastic simulated annealing," *IEEE Trans. Power Syst.*, vol. 21, no. 2, pp. 955-964, May 2006.
- [45] W. Kempton, J. Tomic, S. Letendre, A. Brooks, T. Lipman, "Vehicle-to-grid power: Battery, hybrid and fuel cell vehicles as resources for distributed electric power in California, Davis, CA," *Institute of Transportation Studies*, Report # IUCD-ITS-RR 01-03, 2005.
- [46] J. Tomic and W. Kempton, "Using fleets of electric-drive vehicles for grid support," *Journal of Power Sources*, vol. 168, no. 2, pp. 459-468, 1 Jun 2007.
- [47] W. Kempton and J. Tomic, "Vehicle to grid fundamentals: Calculating capacity and net revenue," *Journal of Power Sources*, vol. 144, no. 1, pp. 268-279, 1 Jun 2005.
- [48] W. Kempton and J. Tomic, "Vehicle-to-grid power implementation: From stabilizing the grid to supporting large-scale renewable energy," *Journal of Power Sources*, vol. 144, no. 1, pp. 280-294, 1 Jun 2005.
- [49] B. D. Williams and K. S. Kurani, "Estimating the early household market for light-duty hydrogen-fuel-cell vehicles and other "Mobile Energy" innovations in California: a constraints analysis," *Journal of Power Sources*, vol. 160, no. 1, pp. 446-453, 29 Sep 2006.
- [50] B. D. Williams and K. S. Kurani, "Commercializing light-duty plug-in/plug-out hydrogen-fuel-cell vehicles: "Mobile Electricity" technologies and opportunities," *Journal of Power Sources*, vol. 166, no. 2, pp. 549-566, 15 Apr 2007.
- [51] W. Kempton and T. Kubo, "Electric-drive vehicles for peak power in Japan," *Energy Policy*, vol. 28, no. 1, pp. 9-18, 2000.